
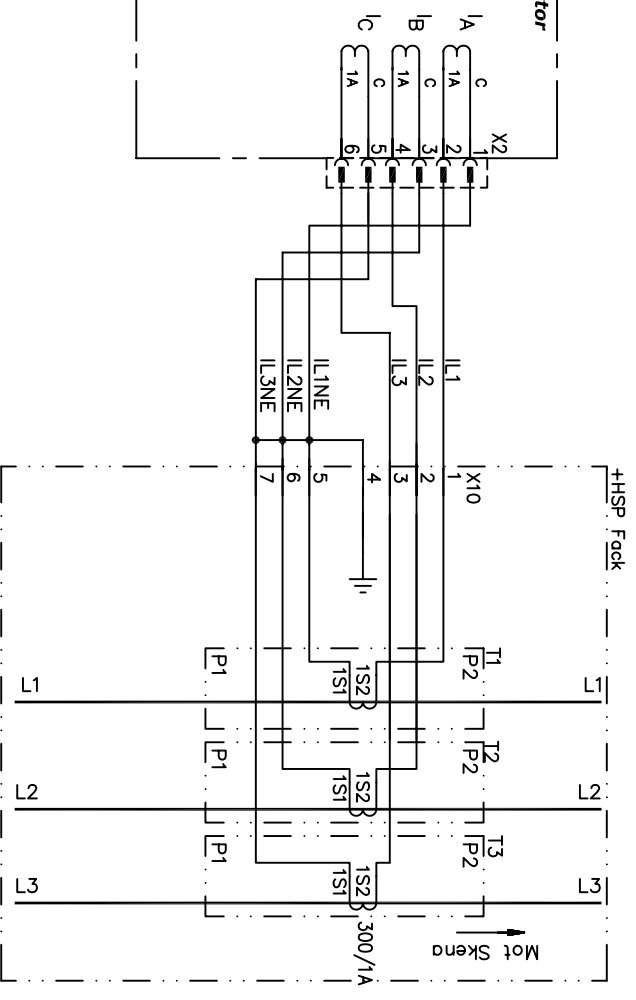


| | | |
|----|-------|---|
| X1 | ① ② ③ | X1:1 NC X1:2 COM X1:3 NO |
| X2 | ① ② ③ | X2:1 LED IN R X2:2 LED IN G X2:3 not used |
| X3 | ① ② ③ | X3:1 LED OUT R X3:2 LED OUT G X3:3 not used |
| X4 | ① ② ③ | X4:1 PWR + X4:2 PWR - X4:3 not used |

POWER SUPPLY: 12-58VDC

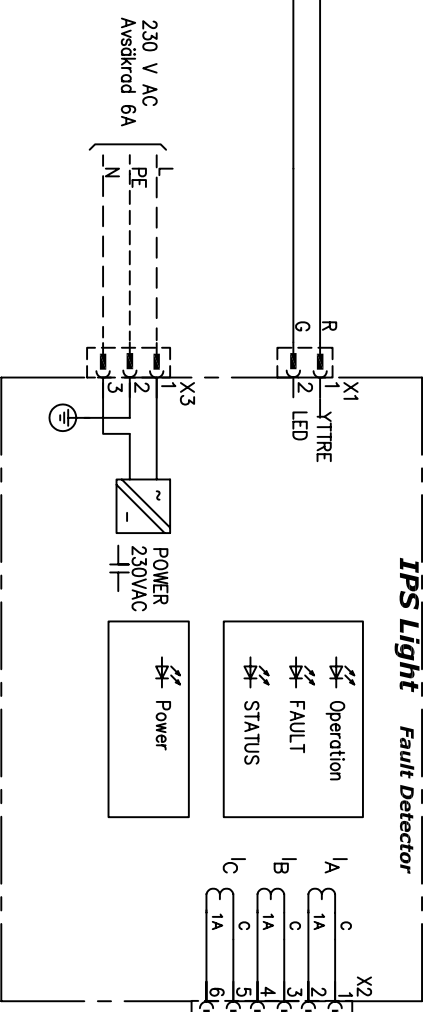

| | | | | | | |
|-------|-----------|------------|--------|---------|---------|--------------------|
| Kndr. | Benämning | Datum | Namn | Normgr. | Anl.nr. | — |
| | | Datum | 091215 | Bearb. | BoA | Connection example |
| | | Godk. | J B | | | RELAY UNIT IPS RU |
| | | Protrol AB | | | | |
| | | Blad 1 | | | | |