IPS2, Indikering via slutande kontakt och LED
/Indication by closing relay and LED

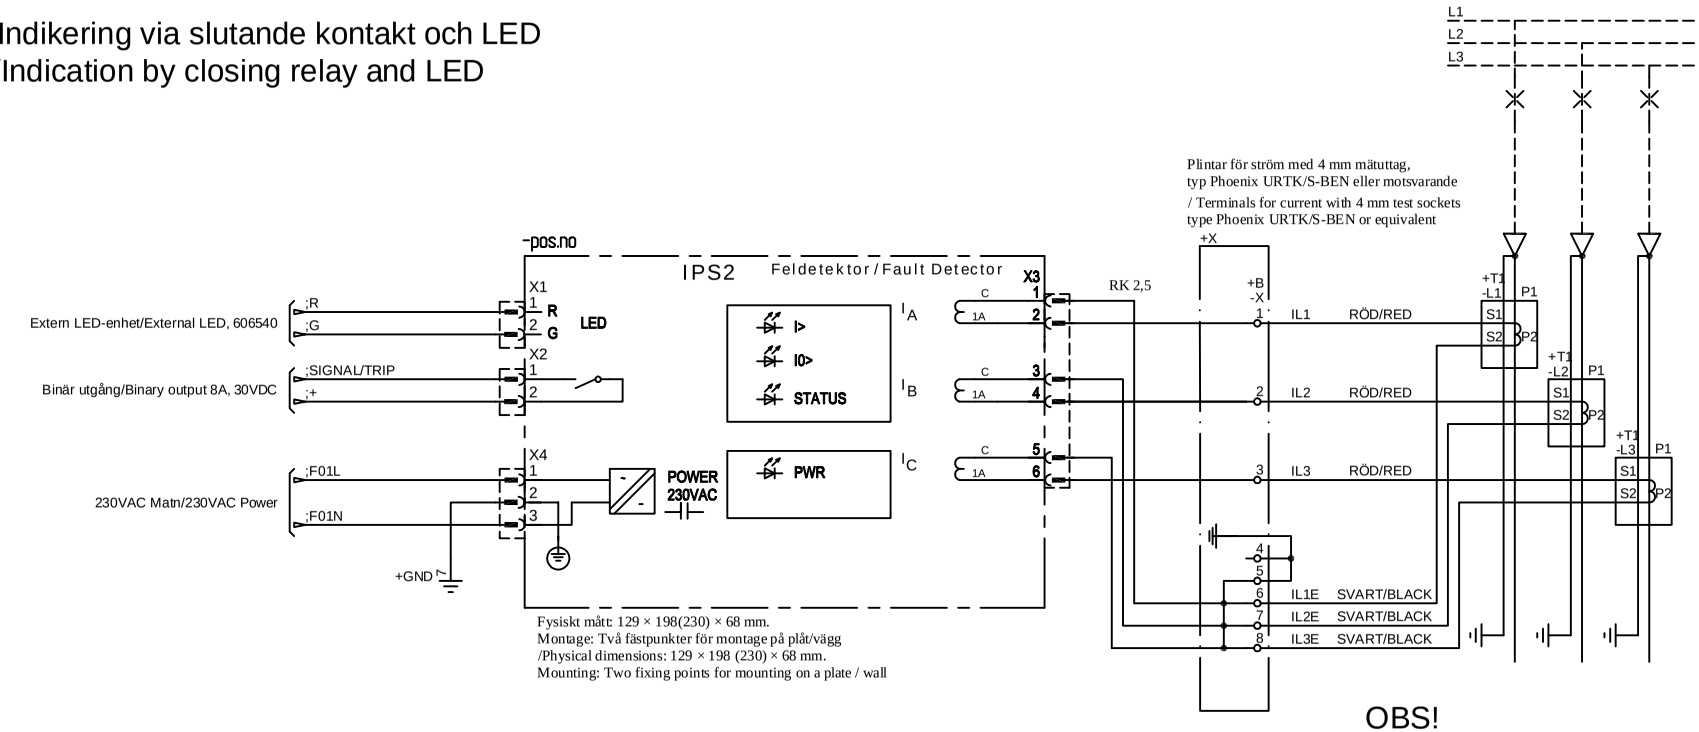

Fysiskt mått: 129 × 198(230) × 68 mm.
Montage: Två fästpunkter för montage på plåt/vägg
/Physical dimensions: 129 × 198 (230) × 68 mm.
Mounting: Two fixing points for mounting on a plate / wall

OBS!

Strömtransformatorn är inte isolerad för högspänning, därför måste skärmen gå med igenom och förbi.
Sedan skall den tillbaka igenom och jordas under strömtransformatorn så att man INTE mäter skärmströmmen

NOTE!

The current transformers are not insulated for high voltage. Thus the cable screen must pass through and pass the CT. The cable screen shall then return through the CT and be earthed, so that the screen current is NOT measured.

Rev In	Revision	Appd	Year Week

Feldetektor för överström och jordfel
Fault detector for overcurrents and earth faults
IPS2, 230 VAC 101122

Design checked by	MM
Drawing checked by	TK
Drawn by	BoA

Kretsschema/Circuit Diagram
-
Standard

Protrol

Dept	Year Week
GBG	151029

ST-2015-02 KS
101122

Rev In	Sheet
Rev In	Sheet 1
	Cont --